ALTERATION	DRAWING NO.
	100-737

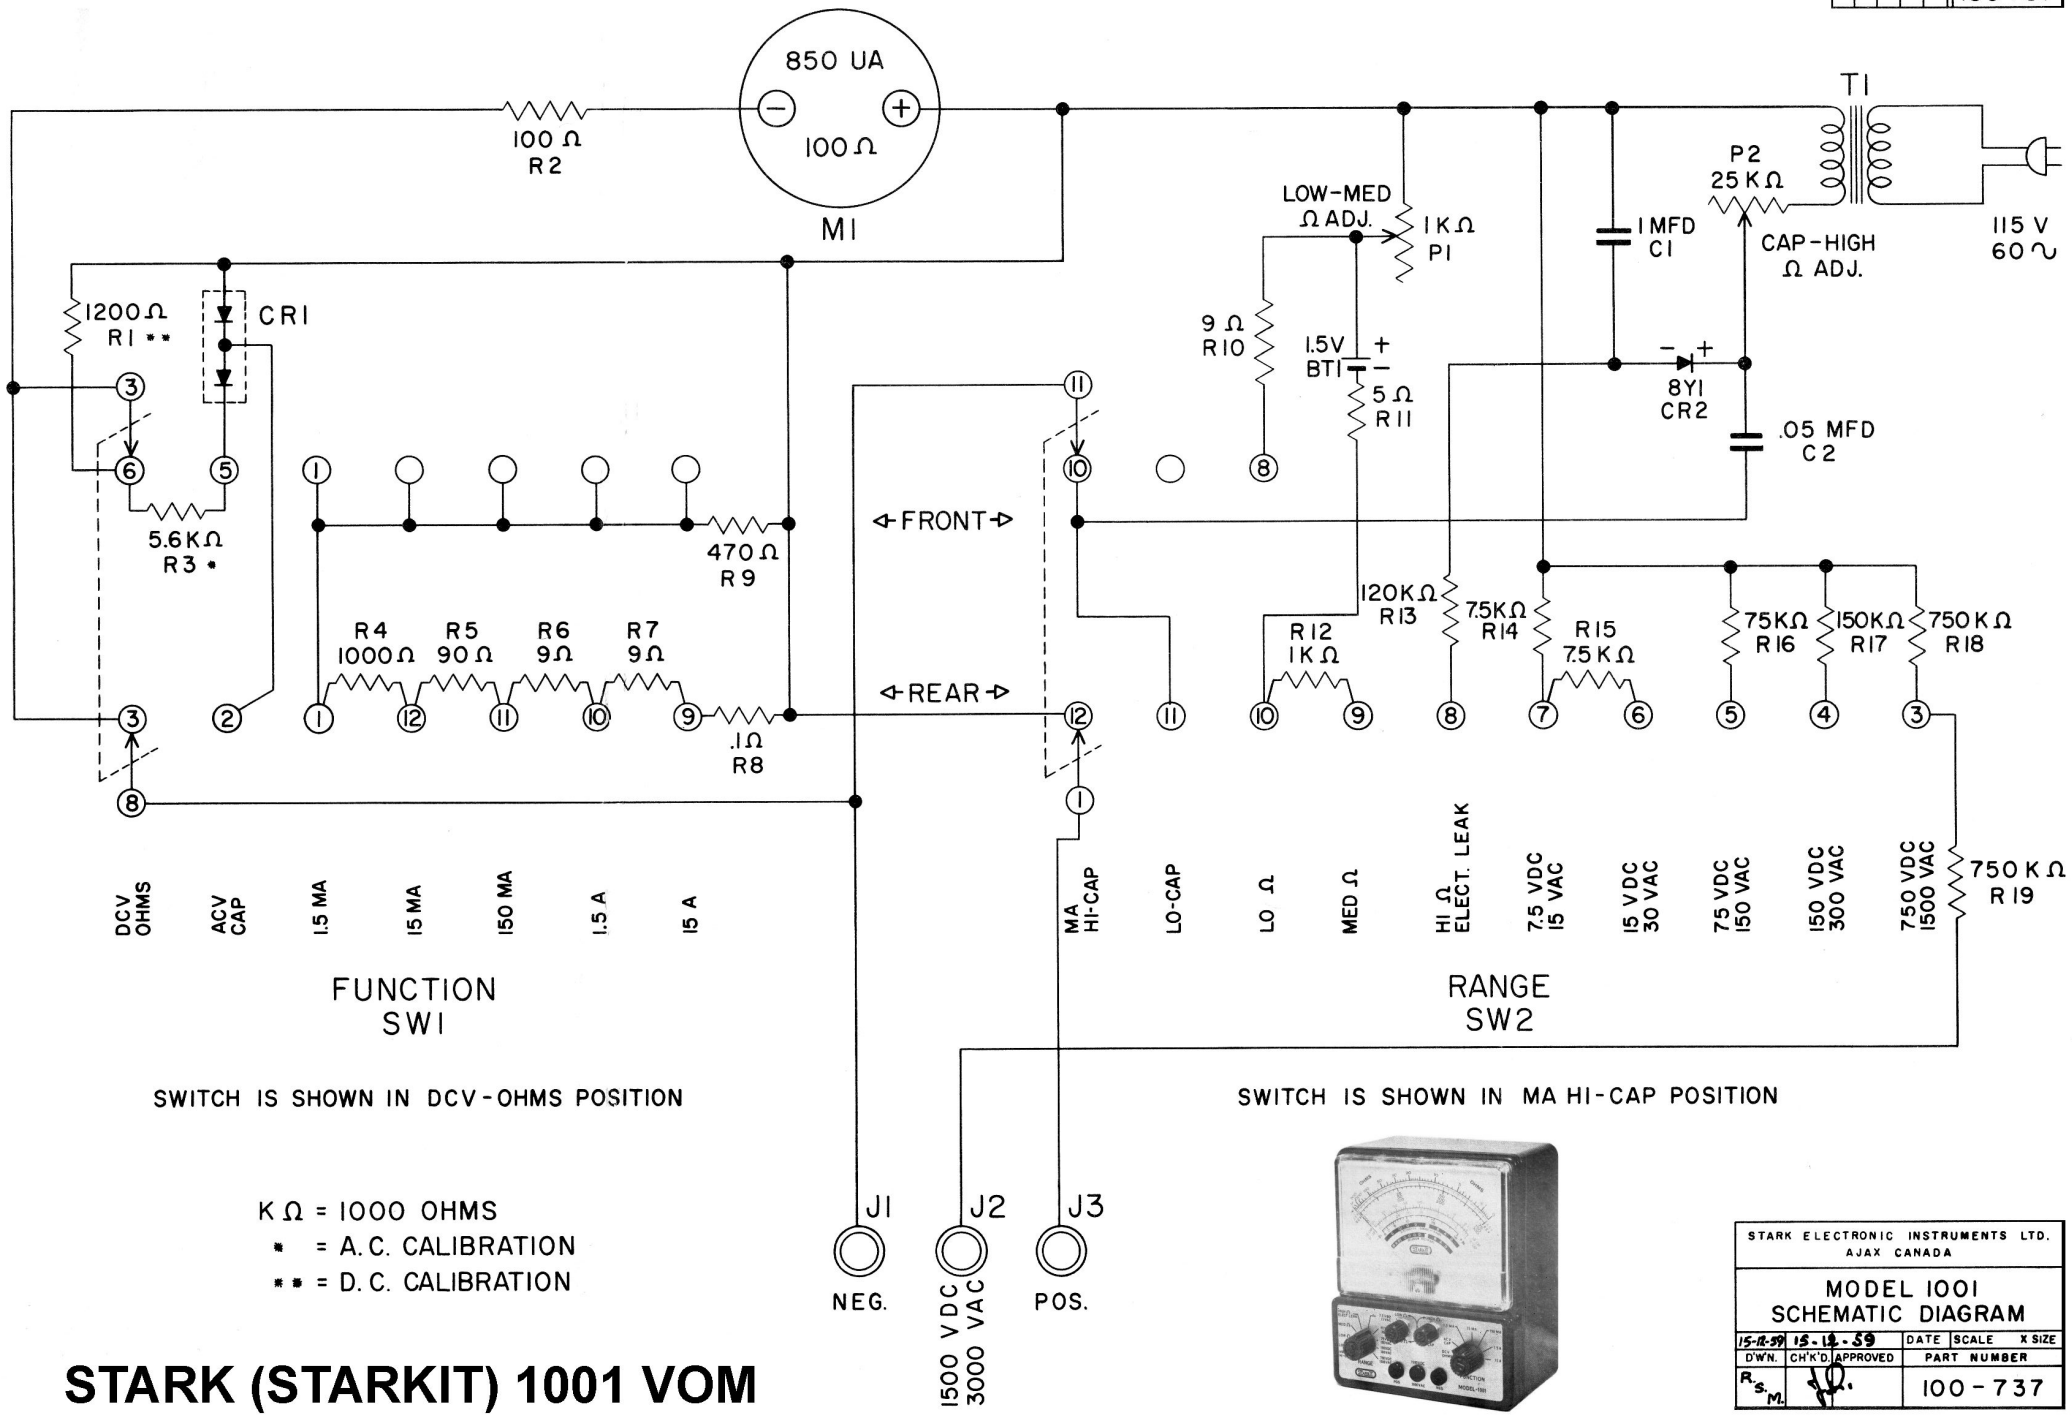

SWITCH IS SHOWN IN DCV-OHMS POSITION

SWITCH IS SHOWN IN MA HI-CAP POSITION

KΩ = 1000 OHMS
* = A.C. CALIBRATION
** = D.C. CALIBRATION

STARK (STARKIT) 1001 VOM

STARK ELECTRONIC INSTRUMENTS LTD.
AJAX CANADA

MODEL 1001
SCHEMATIC DIAGRAM

D'WN.	CH'K'D.	APPROVED	DATE	SCALE	X SIZE
15-12-59	R.S. M.		15-12-59		

PART NUMBER 100-737