


TRIPLETT 1210A

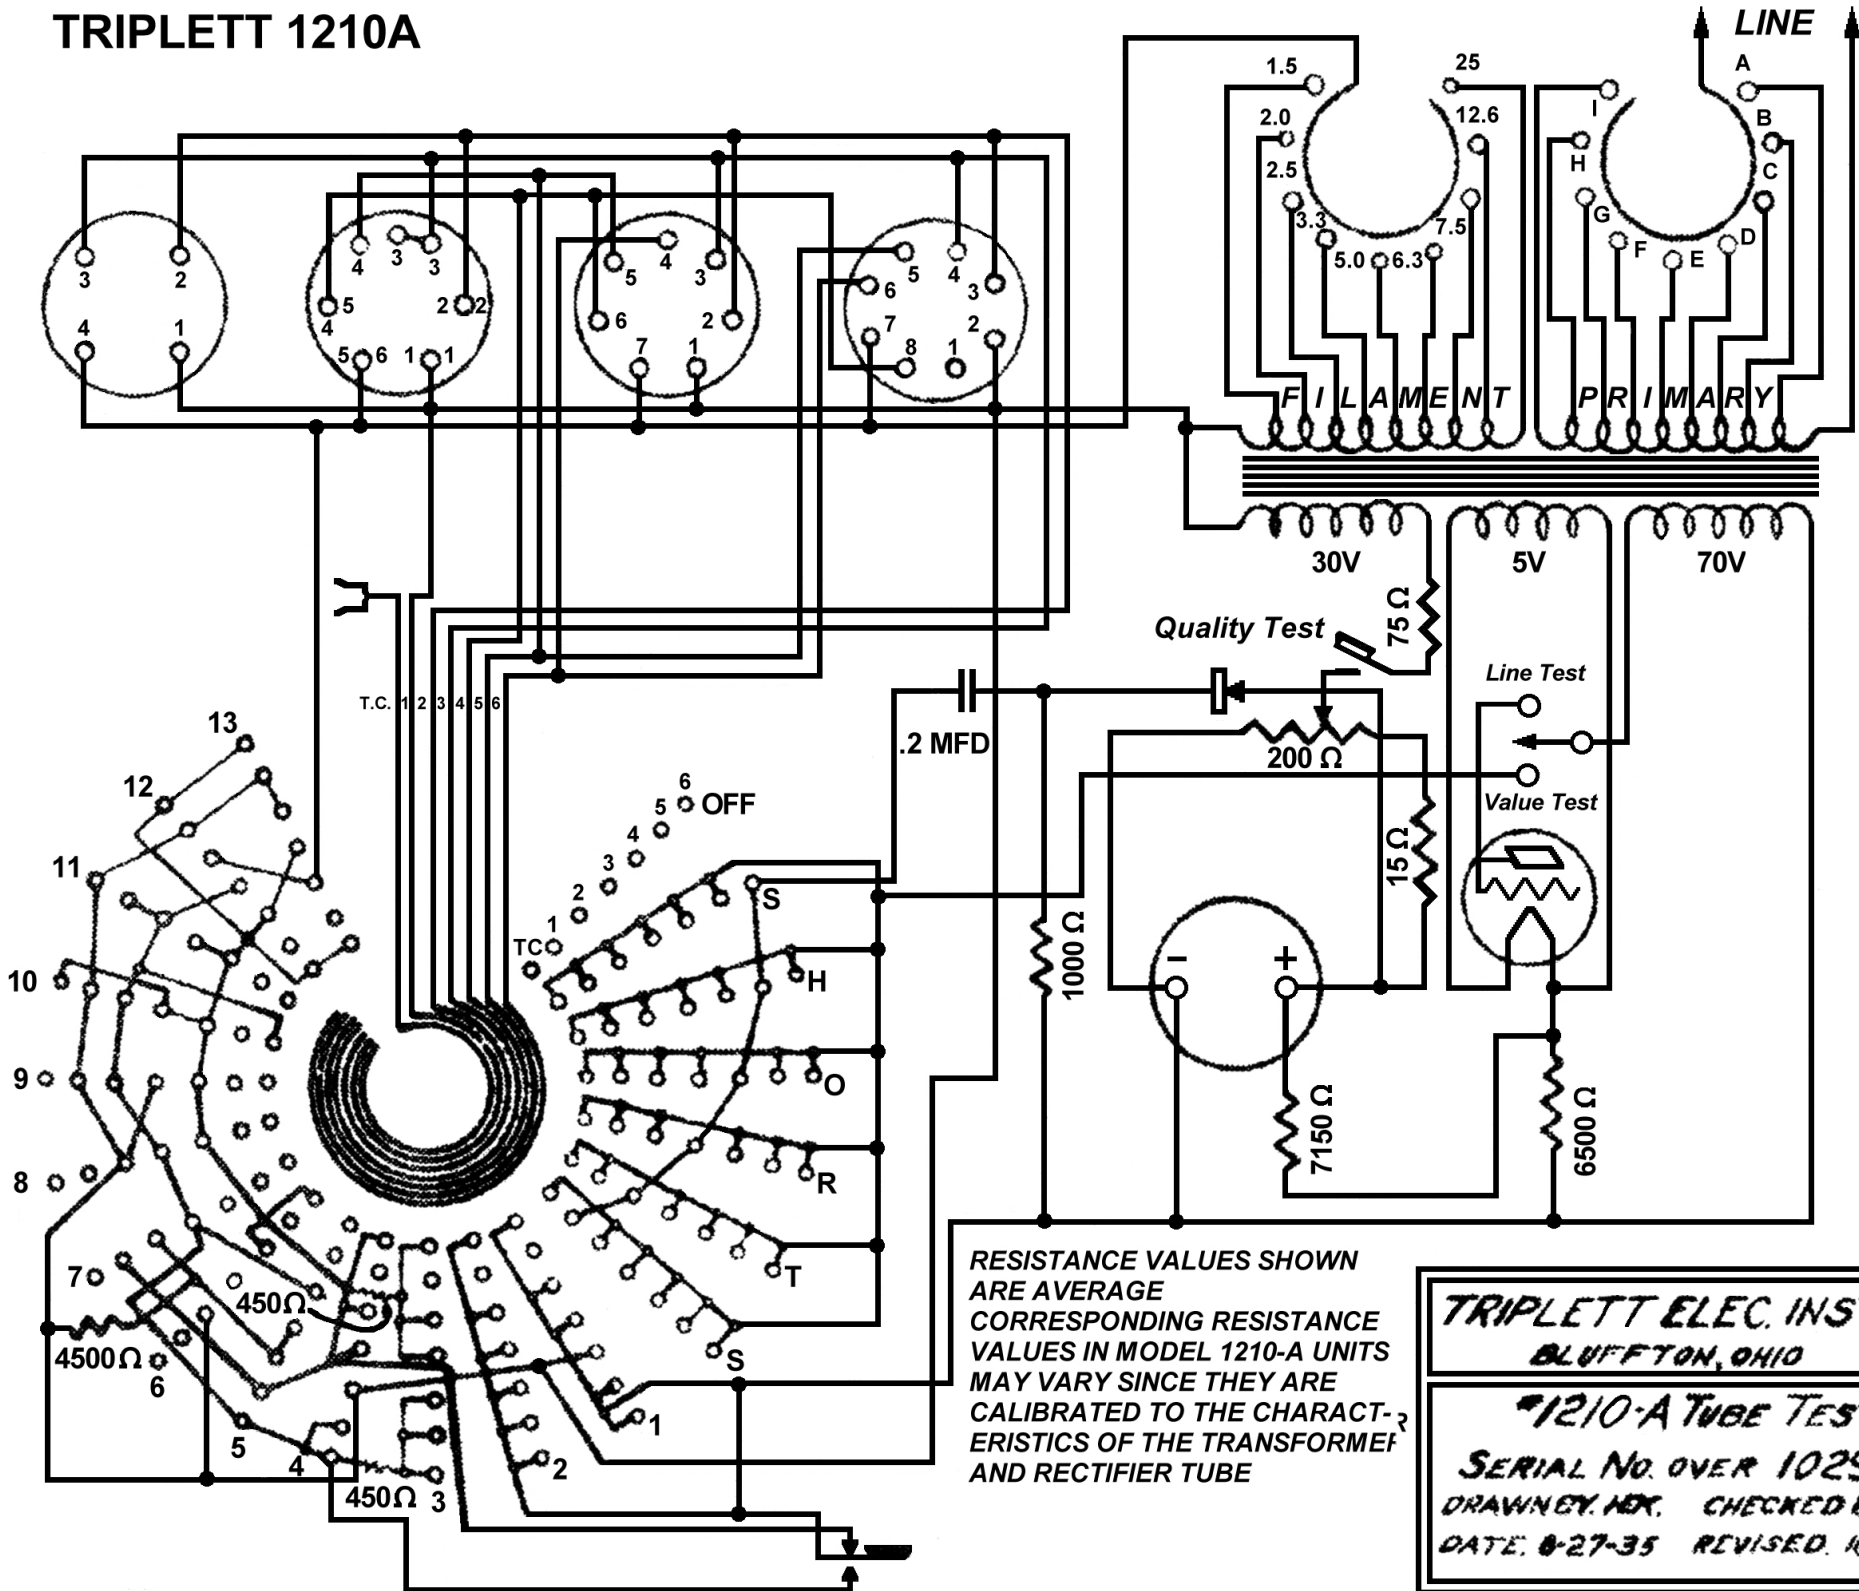

RESISTANCE VALUES SHOWN
 ARE AVERAGE
 CORRESPONDING RESISTANCE
 VALUES IN MODEL 1210-A UNITS
 MAY VARY SINCE THEY ARE
 CALIBRATED TO THE CHARACTERISTICS OF THE TRANSFORMER
 AND RECTIFIER TUBE

TRIPLETT ELEC. INST. CO.
 BLUFFTON, OHIO

***1210-A Tube Tester**
 SERIAL NO. OVER 102926
 DRAWN BY NEX. CHECKED BY M.L.
 DATE: 8-27-35 REVISED: 10-22-35